

# Willis Industrial Park, Grand Ledge – Existing Facilities



Existing 46 kV  
Facilities


Existing 138 kV  
Facilities

Gas Distribution

WORKING TO DELIVER THE ENERGY YOU NEED, WHENEVER YOU NEED IT. **THAT'S OUR PROMISE TO MICHIGAN!**



# Willis Industrial Park, Grand Ledge – Existing Facilities

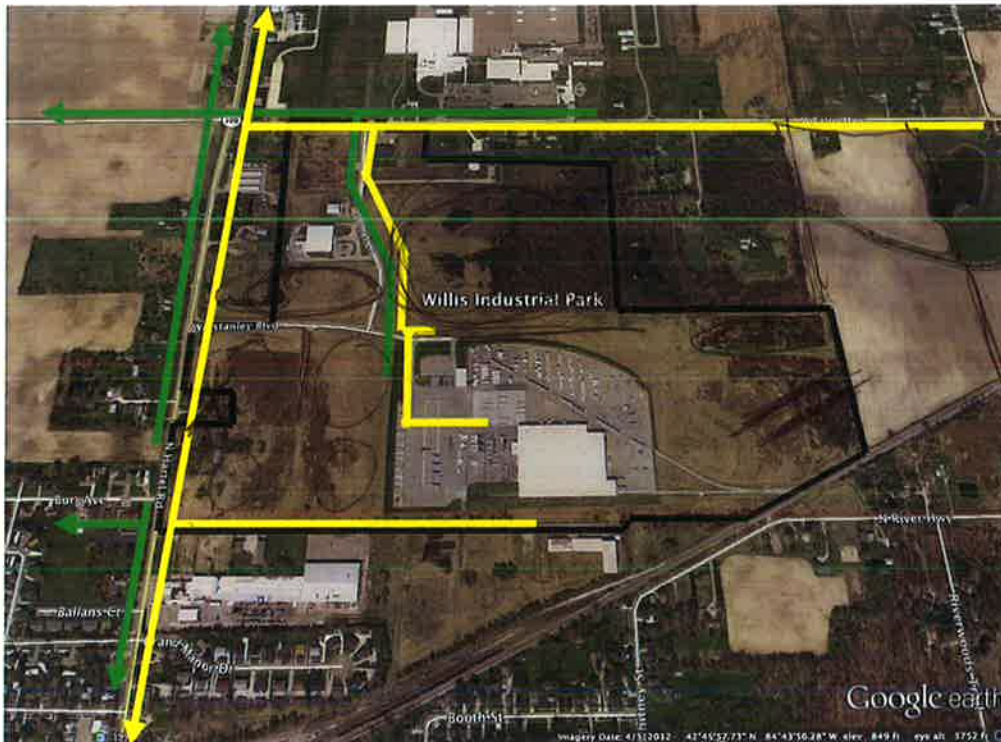

Electric Distribution

Gas Distribution

## Electric Site Benefits

- Distribution System rated to a maximum electric demand of 4MW.
- 46kV System
  - Rated of a minimum demand of 4MW and a maximum electric demand of 15 MW
  - Predicted reliability of 99.996% for 46kV system. The predicted reliability percentage represents the estimated amount of time the facility is in service.
  - Close proximity to the 46kV system that is approximately 1.0 miles away to serve this location.
- 138kV Systems:
  - Rated of a minimum demand of 15 MW and a maximum electric demand of 100 MW
  - Predicted reliability of 99.992% for 138kV system. The predicted reliability percentage represents the estimated amount of time the facility is in service.
  - The 138kV systems is approximately 4.0 miles away to serve this location

## Gas Site Benefits

- Four-inch high-capacity gas main currently available for connection
- Up to 30 psig delivery pressures available, depending upon customer load requirements
- Competitive delivery rates and minimal upfront costs
- Great site for light industrial use

WORKING TO DELIVER THE ENERGY YOU NEED, WHENEVER YOU NEED IT. **THAT'S OUR PROMISE TO MICHIGAN!**



**Consumers Energy**  
Count on Us