


Energy Profile – Grand Ledge Willis Industrial Park

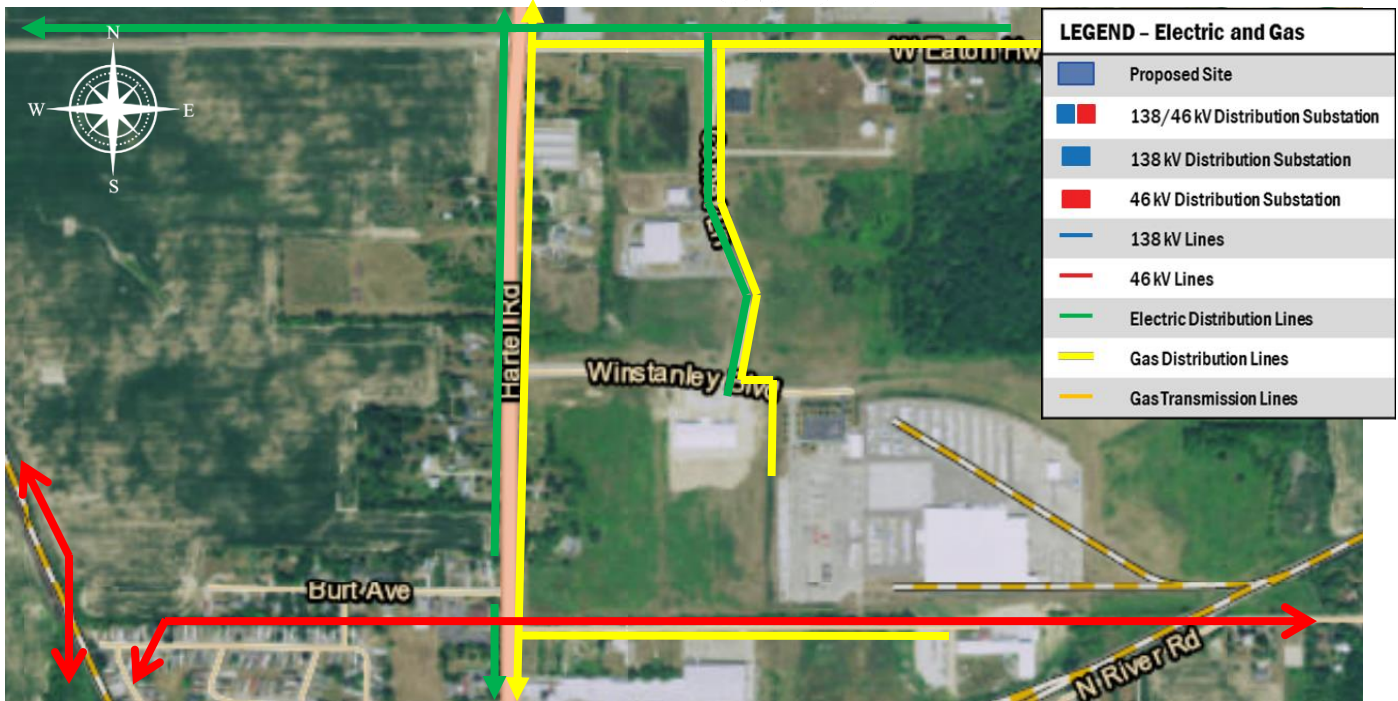

All existing facility locations are approximate and are not to be used for construction purposes. Always contact MISS DIG 811 before you dig.

Electric Site Benefits

- **Distribution system**
 - Predicted reliability of up to 99.730% for 14.4/24.9kV system.
 - The distribution system is located on site.
 - Currently rated for a maximum electric demand of 2.0 MW.
- **46 kV System**
 - Predicted reliability of up to 99.996% . The predicted reliability percentage represents the estimated amount of time the facility is in service.
 - The 46kV system is located adjacent to site.
 - Facilities would be sized to meet the energy needs of the customer and available system capacity determined at the time of a specific request.
- **138 kV System**
 - Predicted reliability of up to 99.992% . The predicted reliability percentage represents the estimated amount of time the facility is in service.
 - The 138kV system is located approximately 4.0 miles north.
 - Facilities would be sized to meet the energy needs of the customer and available system capacity determined at the time of a specific request.

Gas Site Benefits

- Multiple medium-capacity gas mains currently available.
- Up to 20 psig delivery pressures readily available, depending upon customer load requirements.
- Competitive delivery rates and minimal upfront costs.

For additional information

Scott Corrin, Economic Development Manager | 517-374-2248 | scott.corrin@cmsenergy.com